



This article will cover how to manually update your ITM-9000 V2 units with the V189 version firmware to V194. Note that ITM-9000 V2 units will have a built-in multimeter with ports on the bottom. If your ITM-9000 does not have this, it is considered an ITM-9000V1 and will not be eligible for this upgrade.

Prerequisites

- ITM-9000 V2 updated to V189 via online update
- USB adapter cable (this is included in the accessory bag of the ITM-9000)
- Computer/ PC
- Firmware for ITM-9000. This can be found here:
https://icr-eb-bucket.s3.amazonaws.com/storage/firmware/ICR_ITM-9000V2_V194_upgrade.zip

Instructions



Step 1 Connect the Tester (ITM-9000) with the USB cable to a PC, select **Settings > Start USB storage** on the Tester, and then the Tester will switch to USB mode (you can then navigate to the storage path on your PC).

Step 2 On the PC, unzip the existing installation package, and you will get 3 files; copy these 3 files to the root directory of the Tester.

Name	Date modified	Type	Size
 hdct_dedicate_0193_DTT14927658.data	3/8/2022 9:41 AM	DATA File	961 KB
 hdct_share_0193.data	3/8/2022 9:41 AM	DATA File	48,048 KB
 hdctupgrade	3/8/2022 9:41 AM	File	1 KB



Step 3 Follow the on-screen prompts to restart the Tester.

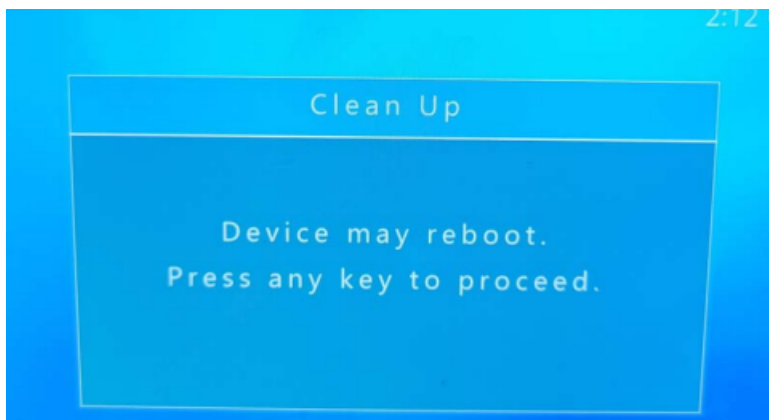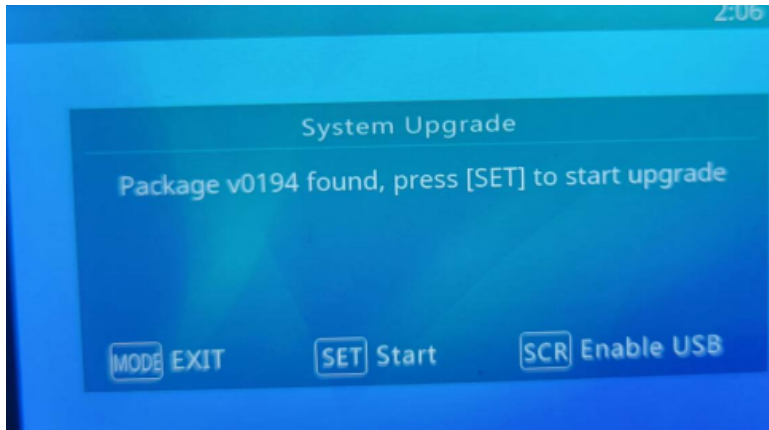

Step 4 On the Tester, navigate to **Settings > System Upgrade** to check whether the system version is consistent with the update file (V194).